


2500 KVA TRANSFORMER PAD SPECIFICATIONS

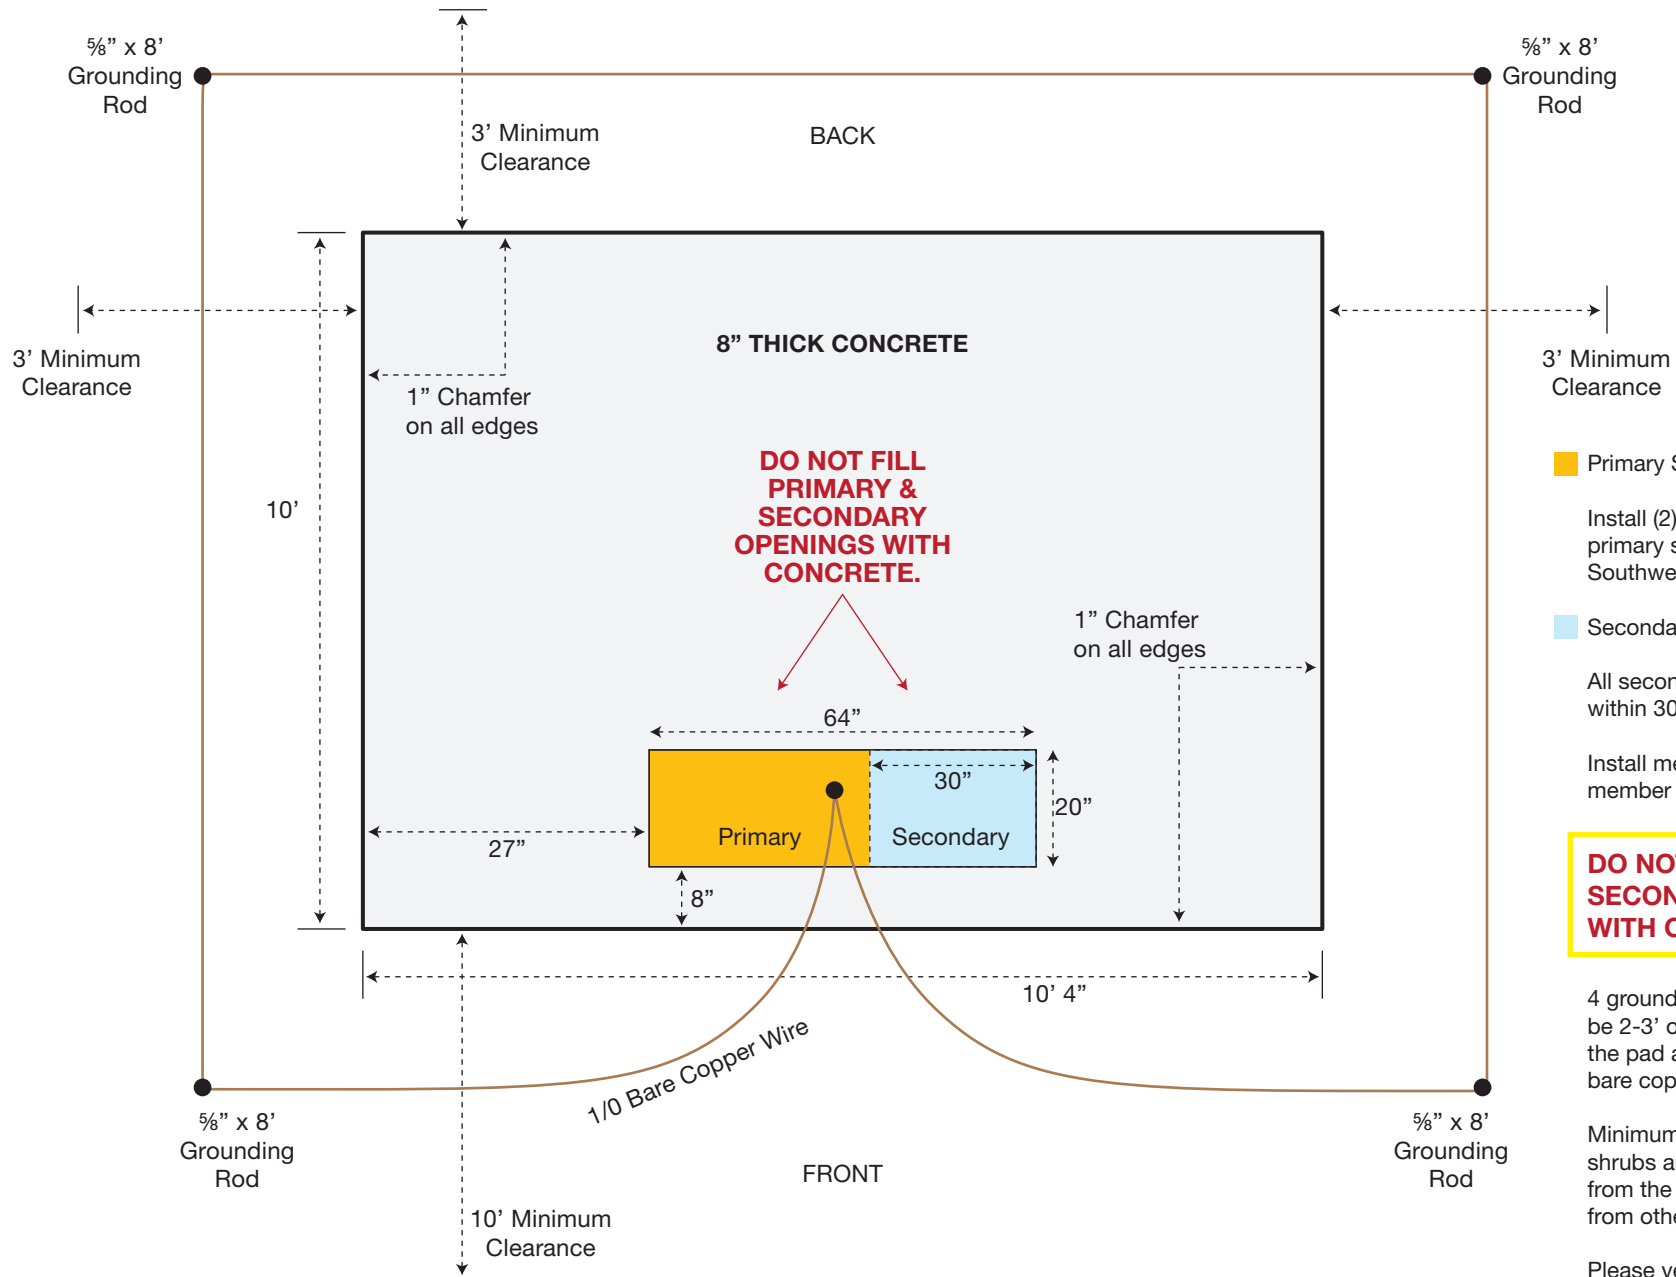

Primary Side (Southwestern)

Install (2) 4" sweep elbows in primary side (supplied by Southwestern).

Secondary Side (Member Side)

All secondary conduit must be within 30" x 20" area indicated.

Install member's conduit in member side (sized by member).

DO NOT FILL PRIMARY & SECONDARY OPENINGS WITH CONCRETE.

4 grounding rods (5/8" x 8') should be 2-3' outside the perimeter of the pad and connected with 1/0 bare copper wire.

Minimum Clearance: Please keep shrubs and structures 10' away from the side with doors and 3' from other sides.

Please verify pad size and location with engineer before installation.

Pad should be 3" above final grade.

