


200 AMP SERVICE, METER ON HOUSE

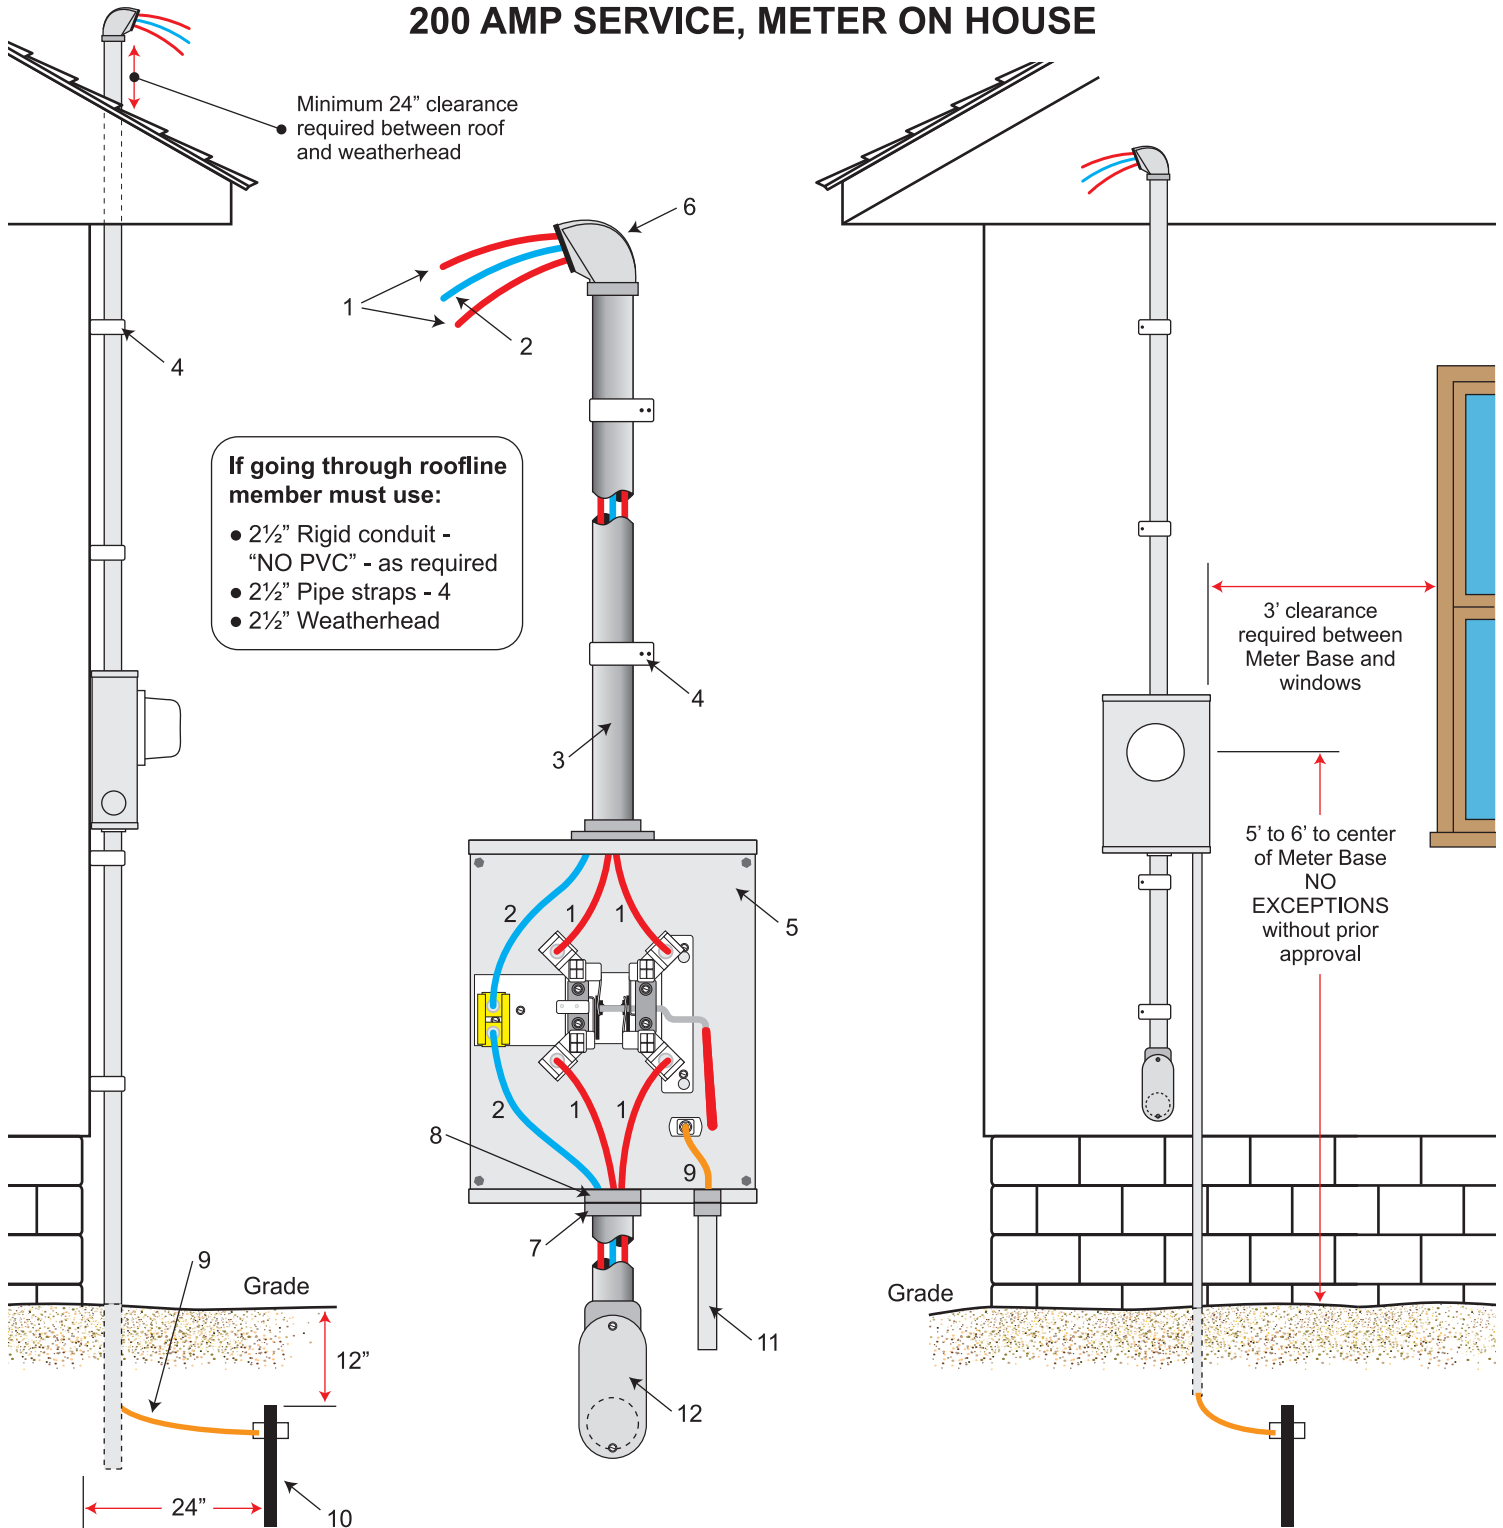

Material List

- | | |
|--|---|
| <ol style="list-style-type: none"> 1. 3/0 Copper conductor - as required 2. 3/0 Copper conductor - Neutral* - as required 3. 2" Rigid conduit - "NO PVC" - as required 4. 2" Pipe straps - 4 5. Meter socket (free from Southwestern Electric) 6. 2" Weatherhead 7. 2" Locknuts - 2 8. One bushing (insulated type) - 2" | <ol style="list-style-type: none"> 9. #4 SDBC Ground Wire** - as required 10. Ground rod & clamp 8' x 5/8" CWC - one each 11. ½" Rigid Conduit - as required 12. LB Fitting - if required |
|--|---|

* Neutral must be continuous from weatherhead through meter socket into panel

** Check applicable zoning requirements

